



TRANSMISSION CORPORATION OF ANDHRA PRADESH LIMITED
STANDARDISED GUARANTEED TECHNICAL PARTICULARS
FOR SOLID CORE INSULATORS (POST TYPE)

Sl. No	Discription	units	Solid Core Insulators		
		kV	245kV	145kV	36kV
1	Manufacturer				
2	Standard		IS-2544 / IEC-60168		
	The type tests should have been conducted not earlier than 5 years in the Standard third party laboratory. The Manufacturer shall produce the type test reports at the time of acceptance tests.				
3	Type		SOLIDCORE POST TYPE		
4	Insulating material		ALUMINA PORCELAIN		
5	No.of units per stack	Nos.	TWO	ONE	ONE
6	Diameter of the largest shed(mm)	mm	245	210	170
7	Height of insulator stack mm	mm	2300 +/- 3.5	1500 +/- 2.5	508 +/- 1.0
8	Height of each basic unit mm	mm	2300 +/- 3.5	1500 +/- 2.5	508 +/- 1.0
9	Weight kgs (Approx)	kgs	125	64	15
10	Total creepage distance (minimum) mm	mm	6125	3625	900
11	Flashover Voltage				
	Power Frequency Flashover Voltage Dry kV	kV	525	365	100
	Power Frequency Flashover Voltage Wet kV	kV	500	305	85
	Impulse Flashover Voltage kV	kV	1150 +ve and 1160-ve	700	235
12	Power Frequency Withstand test voltage	kV			
	Dry kVp	kV	480	335	85
	Wet kVp	kV	460	275	75
	Impulse kV	kVp	1050	650	200
13	Power frequency puncture withstand voltage kV				
14	Working Voltage kV	kV	245	145	36

APPROVED FOR TURNKEY PROJECTS



CHIEF ENGINEER / CONSTRUCTION-1
APTRANSCO/VIDYUTH SOUDHARA/VD.

**STANDARDISED GUARANTEED TECHNICAL PARTICULARS
FOR SOLID CORE INSULATORS (POST TYPE)**

Sl. No	Discription	units	Solid Core Insulators		
15	Mechanical strength				
	a) Cantilever strength	kN	6	6	6
	b) Tensile strength	kN	110	80	50
	c) Torsion Strength	kNm	4.5	4.5	2.5
	d) Compression Strength	kN	220	160	100
16	Pitch Circle Diameter (PCD)				
	Top mm	mm	127 +/- 0.5	127 +/- 0.5	76 +/- 0.5
	Bottom mm	mm	225 +/- 1.0	184 +/- 1.0	76 +/- 0.5
17	Quality of material & standard to which conform	BIS			
	The Manufacturer shall produce the valid BIS certification at the time of acceptance tests.				
18	Packing	Packing shall be done with hard season wood as per the specification.			
19	Markings	“APTRANSCO” letters to be indented or embossed on the metallic portion or on the Porcelain body of the SCI.			
		Standardised Guaranteed Technical Particulars for Solid Core Insulator 245kV, 145kV and 36kV			
		STD/GTP-DWG/Approval No. 202 / Revision No. 0			
		Prepared & Approved during October - 2011			

APPROVED FOR TURNKEY PROJECTS


CHIEF ENGINEER / CONSTRUCTION-1
APTRANSCO/VIDYUTH SOUDHA/HYD.

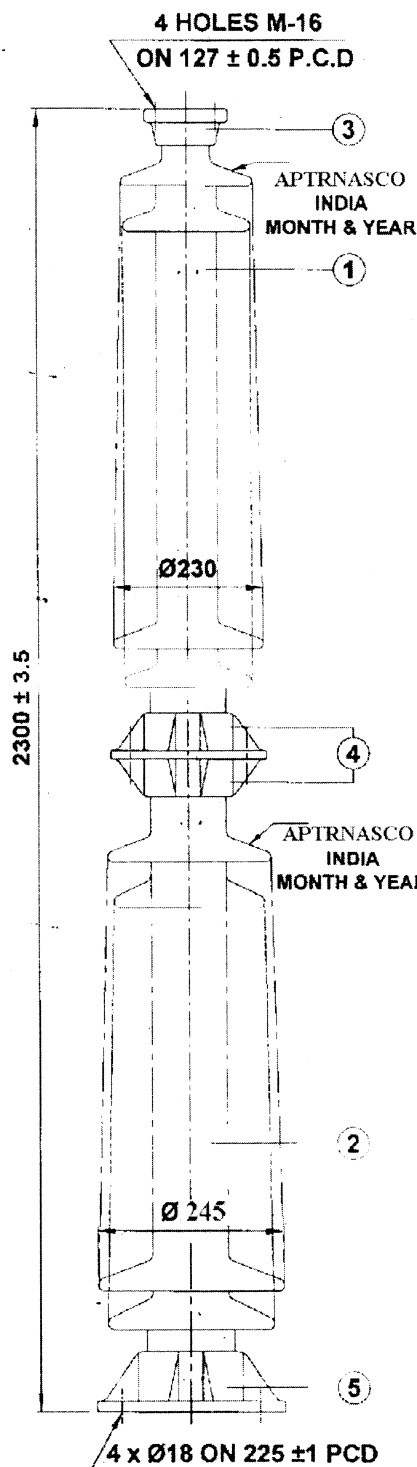**GUARANTEED TECHNICAL PARTICULARS**

ALL DIMENSIONS ARE IN MM

GENERAL :

- STANDARDS APPLICABLE : IS 2544 - 1973 / IS:5350-II-1973/
IEC : 60168 - Ra- 2001
- TYPE OF INSULATOR : SOLIDCORE POST - A- PUNCTURE PROOF
- NO. OF UNITS PER STACK TWO
- MIN. NOM. CREEPAGE DISTANCE MM 6125
- SHED PROFILES CONFORMS TO IEC 60815-1986
- COLOUR OF GLAZE BROWN
- FERROUS PARTS HOT DIP GALVANISED CONFORMS TO
IS : 2633 - 1986, IEC : 60168 - Ra-2001.
- NET WEIGHT (APPROX) KGS 125

MECHANICAL VALUES :

- ULTIMATE CANTILEVER STRENGTH KN 6
- ULTIMATE TORSIONAL STRENGTH KN.M 4.5
- ULTIMATE TENSILE STRENGTH KN 110
- ULTIMATE COMPRESSION STRENGTH KN 270

ELECTRICAL VALUES :

- NOMINAL SYSTEM VOLTAGE KV (rms) 220
- HIGHEST SYSTEM VOLTAGE KV (rms) 245
- DRY POWER FREQUENCY WITHSTAND VOLTAGE KV (rms) 480
- WET POWER FREQUENCY WITHSTAND VOLTAGE KV (rms) 460
- LIGHTNING IMPULSE WITHSTAND VOLTAGE (1.2 / 50 μ SEC. WAVE) KV (peak) 1050
- DRY POWER FREQUENCY FLASHOVER VOLTAGE KV (rms) 525
- WET POWER FREQUENCY FLASHOVER VOLTAGE KV (rms) 500
- VISIBLE (CORONA EXTINCTION) VOLTAGE KV (rms) 156
- IMPULSE FLASHOVER VOLTAGE (1.2 / 50 μ SEC)

POSITIVE	KV (peak)	1150
NEGATIVE	KV (peak)	1160

10. RIV TEST DATA

TEST VOLTAGE TO GROUND

MAX. RIV AT 1 MHz

KV (rms) 156

 μ KV <1000**11. Total Creepage distance**

mm(min) 6125

PACKING PARTICULARS :

- | | TOP | BOT |
|----------------------------------|----------------------|-------|
| 1. No. OF INSULATORS PER CRATE. | 1 | 1 |
| 2. GROSS (PACKED) WEIGHT APPROX. | Kg 74 | 94 |
| 3. PACKED VOLUME | M ³ 0.131 | 0.152 |


APPROVED FOR TURNKEY PROJECTS

[Signature] 25/10/2011
 CHIEF ENGINEER / CONSTRUCTION-1
 APTRANSCO/VIDYUTH SOUDHA/HYD.

3,4,5	CAP & FLANGE	M.C.I. / S.G.I.	4	HOT - DIP - GALVANIZED
1 & 2	INSULATOR BODY	ALUMINA PORCELAIN KER - 110.2	2	BROWN GLAZED
SL. No.	DESCRIPTION	MATERIAL	No.OFF	FINISH
CUSTOMER REF. APTRANSCO			SCALE NTS	

**Standardised Drawing for Solid Core Insulator 220 / 245kV****STD/GTP-DWG/Approval No. 203 - 1 / Revision No. 0****Prepared & Approved during October - 2011****Nitro PDF Software**100 Portable Document Lane
Wonderland

ALL DIMENSIONS ARE IN MM

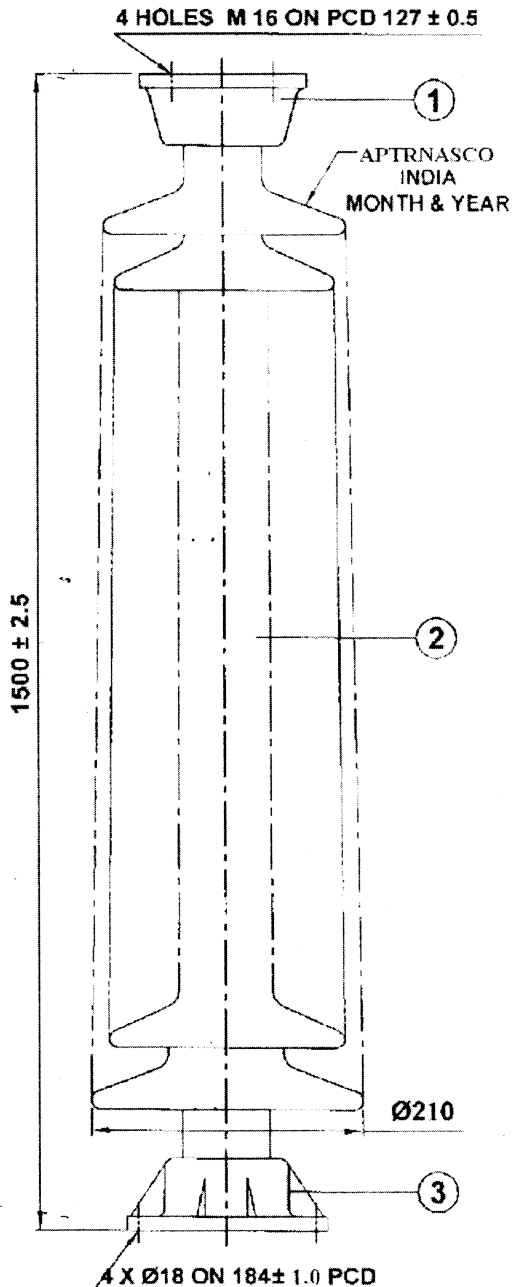**GUARANTEED TECHNICAL PARTICULARS****GENERAL :**

- | | |
|---|---------|
| 1. STANDARDS APPLICABLE : IS 2544 - 1973 / IEC : 168 - 2001 | |
| 2. TYPE OF INSULATOR : SOLIDCORE POST TYPE | |
| 3. NO. OF UNITS PER STACK | ONE |
| 4. MIN. NOM. CREEPAGE DISTANCE | MM 3625 |
| 5. SHED PROFILES CONFORMS TO IEC 815-1986 | |
| 6. FERROUS PARTS HOT DIP GALVANISED AS PER IS : 2633 - 1986 | |
| 7. DRY ARCING DISTANCE | MM 1360 |
| 8. APPROX WEIGHT | Kg 64 |

MECHANICAL VALUES :

- | | | |
|----------------------------------|------|-----|
| 1. ULTIMATE CANTILEVER STRENGTH | KN | 6 |
| 2. ULTIMATE TORSIONAL STRENGTH | KN.M | 4.5 |
| 3. ULTIMATE TENSILE STRENGTH | KN | 80 |
| 4. ULTIMATE COMPRESSION STRENGTH | KN | 160 |

ELECTRICAL VALUES :

- | | | |
|--|-----------|-------|
| 1. NOMINAL SYSTEM VOLTAGE | KV (rms) | 132 |
| 2. HIGHEST SYSTEM VOLTAGE | KV (rms) | 145 |
| 3. DRY POWER FREQUENCY WITHSTAND VOLTAGE | KV (rms) | 335 |
| 4. WET POWER FREQUENCY WITHSTAND VOLTAGE | KV (rms) | 275 |
| 5. LIGHTNING IMPULSE WITHSTAND VOLTAGE
(1.2 / 50 μ SEC. WAVE) | KV (peak) | 650 |
| 6. DRY POWER FREQUENCY FLASHOVER VOLTAGE | KV (rms) | 365 |
| 7. WET POWER FREQUENCY FLASHOVER VOLTAGE | KV (rms) | 305 |
| 8. IMPULSE FLASHOVER VOLTAGE
(1.2 / 50 μ SEC) +VE / -VE WAVE | KV (Peak) | 700 |
| 9. VISIBLE (CORONA EXTINCTION) VOLTAGE | KV (rms) | >105 |
| 10. RIV TEST DATA | | |
| TEST VOLTAGE TO GROUND | KV (rms) | 105 |
| MAX. RIV AT 1 MHz | μ KV | <1000 |
| 11. Total Creepage distance | mm(min) | 3625 |

PACKING PARTICULARS :

- | | |
|------------------------------------|------------------------|
| 1. No. OF INSULATORS PER CRATE. | 1 |
| 2. GROSS (PACKED) WEIGHT (APPROX.) | Kg 86 |
| 3. PACKED VOLUME | M ³ 0.03887 |

APPROVED FOR TURNKEY PROJECTS

CHIEF ENGINEER / CONSTRUCTION
APTRANSCO/VIDYUTH SOUTHERN


3	FLANGE	M.C.I. / S.G.I.	1	HOT - DIP - GALVANIZED
2	INSULATOR BODY	ALUMINA PROCELAIN KER - 110 - 2	1	BROWN GLAZED
1	CAP	M.C.I. / S.G.I.	1	HOT - DIP - GALVANIZED
SL. No.	DESCRIPTION	MATERIAL	No.OFF	FINISH
CUSTOMER REF APTRANSCO			SCALE NTS	




Standardised Drawing for Solid Core Insulator 132 /145kV
STD/GTP-DWG/Approval No. 203 - 2 / Revision No. 0

Prepared & Approved during ON Nitro PDF Software


100 Portable Document Lane
Wonderland



4 HOLES M-12
ON 76 ± 0.5 P.C.D.
Ø105

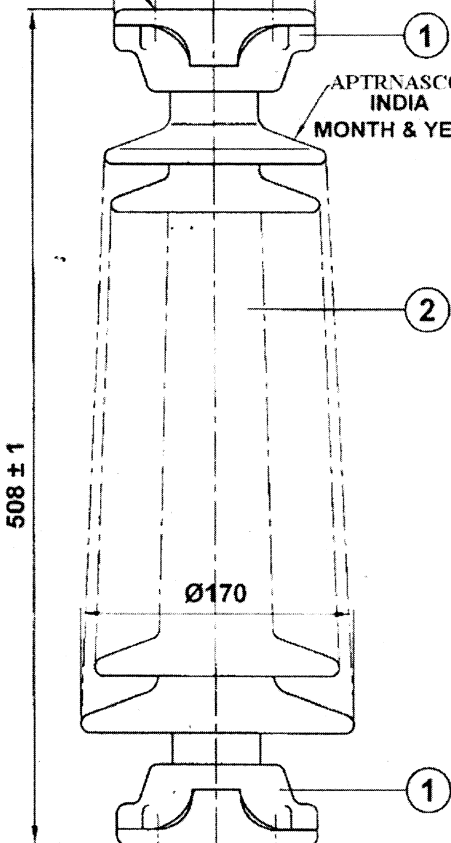

4 HOLES M-12
ON 76 ± 0.5 P.C.D.



GUARANTEED TECHNICAL PARTICULARS

GENERAL :

- STANDARDS APPLICABLE : IS 2544 - 1973 / IS:5350-II-1973/
IEC : 60168 - Ra- 2001
- TYPE OF INSULATOR : SOLIDCORE POST - A- PUNCTURE PROOF
- NO. OF UNITS PER STACK ONE
- MIN. NOM. CREEPAGE DISTANCE MM 900
- SHED PROFILES CONFORMS TO IEC 60815-1986
- COLOUR OF GLAZE : BROWN
- FERROUS PARTS HOT DIP GALVANISED CONFORMS TO
IS : 2633 - 1986, IEC : 60168 - Ra-2001.
- APPROX WEIGHT KG 15

MECHANICAL VALUES :

- ULTIMATE CANTILEVER STRENGTH KN 6
- ULTIMATE TORSIONAL STRENGTH KN.M 2.5
- ULTIMATE TENSILE STRENGTH KN 50
- ULTIMATE COMPRESSION STRENGTH KN 100

ELECTRICAL VALUES :

- NOMINAL SYSTEM VOLTAGE KV (rms) 33
- HIGHEST SYSTEM VOLTAGE KV (rms) 36
- DRY POWER FREQUENCY WITHSTAND VOLTAGE KV (rms) 85
- WET POWER FREQUENCY WITHSTAND VOLTAGE KV (rms) 75
- LIGHTNING IMPULSE WITHSTAND VOLTAGE
(1.2 / 50 μ SEC. WAVE) KV (peak) 200
- DRY POWER FREQUENCY FLASHOVER VOLTAGE KV (rms) 100
- WET POWER FREQUENCY FLASHOVER VOLTAGE KV (rms) 85
- IMPULSE FLASHOVER VOLTAGE
(1.2 / 50 μ SEC) +VE / -VE WAVE KV (rms) 235
- VISIBLE (CORONA EXTINCTION) VOLTAGE KV (rms) > 27
- Total Creepage Distance mm(min)- 900

PACKING PARTICULARS :

- No. OF INSULATORS PER CRATE. 1
- GROSS (PACKED) WEIGHT APPROX. Kg 30
- PACKED VOLUME M³ 0.074

BOLT & NUT SIZE:-

TOP :- M12 X 35 LONG - 4 NOS

BOTTOM :- M12 X 35 LONG - 4 NOS

APPROVED FOR TURNKEY PROJECTS

CHIEF ENGINEER / CONSTRUCTION - 1
APTRANSO/VIDYUTH SOUDHA/HYD

2	INSULATOR BODY	ALUMINA PROCELAIN KER - 110 - 2	1	BROWN GLAZED
1	CAP	M.C.I. / S.G.I.	2	HOT - DIP - GALVANIZED
SL. No.	DESCRIPTION	MATERIAL	No.OFF	FINISH
CUSTOMER REF APTRANSO			SCALE NTS	



Standardised Drawing for Solid Core Insulator 33 / 36 kV
STD/GTP-DWG/Approval No. 203 - 3 / Revision No. 0

Prepared & Approved during October - 2011